



## G1991 Safety Station with Eyewash, All-Stainless Steel Construction

APPLICATION: All-stainless steel combination eyewash and shower safety station. Stainless steel construction is ideal for highly corrosive environments and clean room applications. Two GS-Plus<sup>™</sup> spray-type outlet heads deliver a flood of water for rinsing eyes.

**SHOWER HEAD:** 10" diameter stainless steel.

**SHOWER VALVE:** 1" IPS Type 316 stainless steel stay-open ball valve. Valve has stainless steel ball and Teflon® seals. Furnished with stainless steel actuating arm and 29" stainless steel pull rod.

**SPRAY HEAD ASSEMBLY:** Two GS-Plus<sup>™</sup> spray heads. Each head has a "flip top" dust cover, internal flow control and filter to remove impurities from the water flow.

**EYEWASH BOWL:** 11 1/2" diameter stainless steel.

**EYEWASH VALVE:** 1/2" IPS Type 316 stainless steel stay-open ball valve. Valve has stainless steel ball and Teflon® seals.

**PIPE AND FITTINGS:** Schedule 40 Type 304 brushed stainless steel. Furnished with orange polyethylene covers for vertical piping for high visibility and corrosion resistance.

SUPPLY: 1 1/4" NPT female top or side inlet.

WASTE: 1 1/4" NPT female outlet.

**SIGN:** Furnished with ANSI-compliant identification sign.

QUALITY ASSURANCE: Valve and spray head assemblies are factory assembled and water tested prior to shipment.

## **Available Options**

**BC** Stainless steel cover for eyewash wash bowl.

**FC20** Regulates shower flow rate to 20 GPM.

AP275-100 Electric Light and Alarm Horn Light and alarm horn summon assistance when eyewash or shower is activated.

## AP250-015 Modesty Curtain

Modesty curtain for mounting on safety station.

**TMV** G<sub>3</sub>800 thermostatic mixing valve precisely blends hot and cold water to deliver warm (tepid) water as required by ANSI Z358.1-2004.





Guardian Equipment 1140 N North Branch St. 312 447 8101 FACSIMILE Chicago, IL 60622

312 447 8100 TELEPHONE gesafety.com







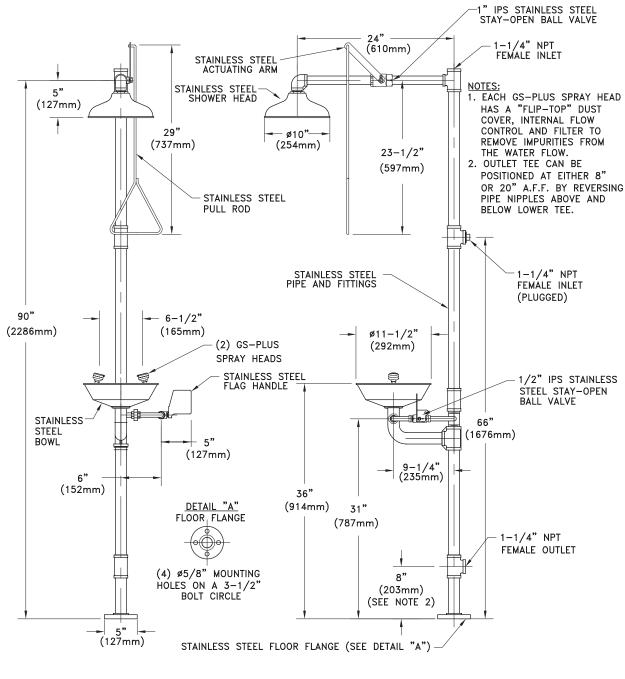

Sign Included



Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are ± 1/4" (6mm). rev. 0308

Guardian Equipment 1140 N North Branch St. 312 447 8101 FACSIMILE Chicago, IL 60622 gesafety.com

THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL

312 447 8100 TELEPHONE

ETL Listed 101496. Units have been tested to and comply with ANSI Z358.1 - 2004