

SPEAKMAN COMPANY

SE-480 Installation, Maintenance & Operation Instructions

EYESAVER® EYE/FACE WASH

DESCRIPTION

Pedestal mounted emergency eye/face wash. Supplied with stainless steel bowl, stay-open full flow ball valve; activated by stainless steel push handle and/or foot pedal; and in-line strainer. All mounted on galvanized steel pipe with drain tee and floor flange. Spray pattern is a 9" x 8" (72 sq. in.) curtain of aerated water, easily controlled at any pressure for maximum protection.

SPECIFICATIONS

BOWL: 300 Series Stainless Steel. (Reference additional SE-300 I,M,O sheet)
SPRAY HEADS: (6) Brass, Chrome-Plated, Aerated.
VALVE: 1/2" NPT Female Brass, Chrome-Plated.
ACTIVATOR: Stainless Steel Push Handle and Stainless Steel Foot Pedal.
SHROUDS: Yellow Polypropylene.
INLET: 1" NPT Female.
STRAINER: Brass, Chrome-Plated, In-Line.
PIPE: 1-1/4" IPS Galvanized Steel.
FLOOR FLANGE: Brass Casting with (3) 17/32" Dia. Mounting Holes on 9" Dia. Bolt Circle, Spaced 120° Apart.
WASTE: 1-1/4" NPT Female.
FINISH: Safety Green Powder Coating.
SHIPPING WEIGHT: 29 lb.
EMERGENCY SIGN: 7-7/8" x 7-7/8" Plastic Wall Sign.

OPTIONS

| | |
|---|--------------------------------------|
| ◇ AL1 (Air Horn Alarm) | ◇ HS (Hand-held Spray) |
| ◇ AL2 (Electrical Alarm) | ◇ FPV (Anti-Freeze Protection Valve) |
| ◇ AL3 (Electrical Alarm) | ◇ SGN4 (Eye Wash Floor Sign) |
| ◇ AL2-C1D2 (Electrical Alarm / Haz. Area) | ◇ SPV (Anti-Scald Protection Valve) |
| ◇ AL3-C1D2 (Electrical Alarm / Haz. Area) | ◇ SSBV2 (1/2" Stainless Steel Valve) |
| ◇ FLW (Flow Switch) | ◇ VPL (Vapor Proof Light) |
| ◇ HFO (Hand & Foot Operation) | ◇ |

INSTALLATION

Review drawing (as shown on other side) to assure proper location of inlet, drain, and foot pedal. Mount stanchion to floor using suitable anchors. Rest the eye/face wash bowl on the rubber washer and drain spud making sure to get the bowl level as possible, to insure a proper flow pattern, and to avoid unnecessary water spillage. Once bowl is positioned correctly on spud, apply plumbers putty to drain strainer and tighten with hex tool (supplied). Connect a water supply to the unit (use pipe sealant on all joints) that is a 1/2" minimum uninterrupted source of potable water. Failure to use potable water can result in emergency units producing impure or contaminated water causing possible further injury. The drain tailpiece or waste should be connected to an adequate drain in compliance with local plumbing codes. Once water supply is connected to unit the spray pattern can be manually adjusted by using a flat head screw driver to rotate the adjusting screw, located in the front of each shroud assembly, while the unit is activated and water is flowing.

OPERATION

The eye/face wash is activated by pushing the push handle back 90° and/or depressing the foot pedal. The unit will continue to operate until the push handle is manually pulled back to the off position.

TESTING PROGRAM

The American National Standards Institute (ANSI) states that all safety emergency equipment shall be activated on a weekly basis to flush the line and verify proper operation. Speakman Company furnishes a testing record tag (91-0635) with each unit. On this tag the date of inspection and the inspectors initials should be noted.


MAINTENANCE

Should you need parts to repair this unit, please reference the parts list below for correct part numbers. Reference additional technical sheet (supplied) for SE-400 eye/face wash. Before any maintenance is done *be sure to shut the water supply off.*

WARNING: Use only genuine Speakman parts when repairing or replacing components. To order parts call 1-800-537-2107.

SE-480 REPLACEMENT/REPAIR PARTS

| <u>ITEM</u> | <u>PART/GROUP #</u> | <u>DESCRIPTION</u> |
|-------------|---------------------|--------------------|
| 1 | SE-400 | Eye/Face Wash |
| 2 | G74-0018-PNT | Stanchion Assy. |
| 3 | H.F.O. | Foot Pedal Assy. |

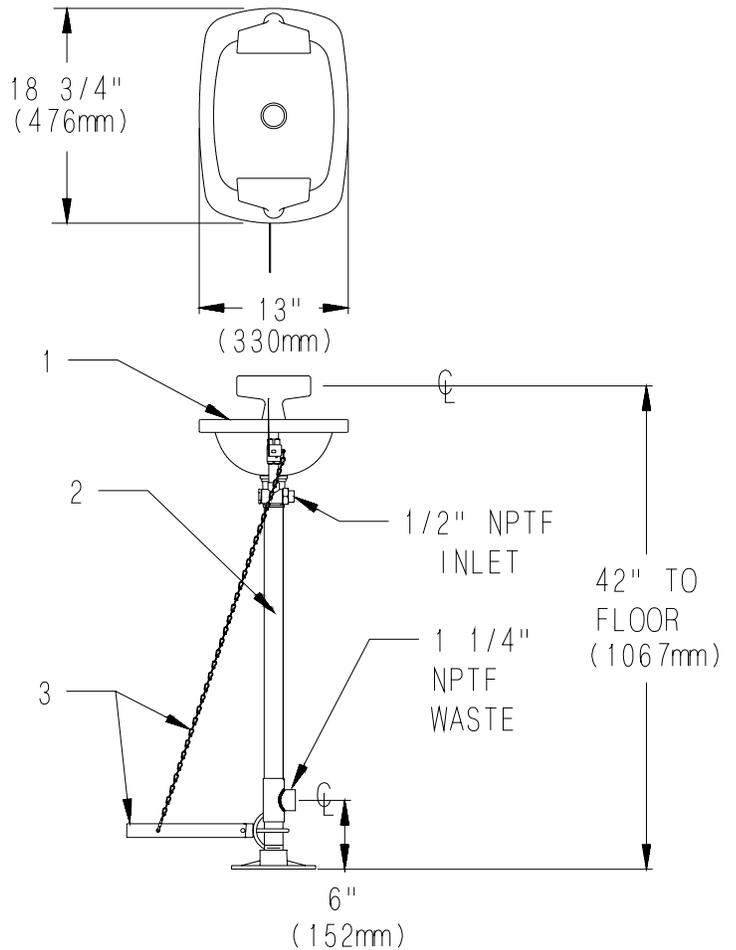

FLOW DATA

EYE/FACE WASH:

| | |
|-------------------------|-------------|
| FLOW PRESSURE PSI (BAR) | 30 (2.07) |
| FLOW RATE GPM (LPM) | 9.55 (16.6) |

NOTE: This unit should be connected to an uninterrupted source of potable water, with a minimum flowing pressure of 20 PSI and a maximum static pressure of 125 PSI.

Note: All units meet existing ANSI Z358.1 Standards and OSHA Rules. Product improvements may cause specification and dimensional changes without notice.

SPEAKMAN®

PO Box 191 Wilmington, DE 19899

Phone: 800-537-2107 Fax: 800-977-2747

Visit us on the web at www.speakmancompany.com