

# Frostproof, Wall-Mounted Eyewash Fixture

## Model S19-220HFP

- Complies with American National Standard Z358.1-2004
- Galvanized Steel Protected with BRADTECT™ Safety Yellow Coating
- Universal Identification Sign and Inspection Tag Included
- Full, One-Year Warranty

### Specifications

This unit is made specifically for areas subject to freezing. Compact eyewash fits easily into any work environment. Eyewash operates quickly by a stainless steel push flag handle. Safe, steady water flow under varying water supply conditions from 30-90 PSI is assured by integral flow control in the sprayhead assembly.

#### UPC and cUPC Approved:

The Emergency Fixtures are certified to comply with the requirements of the Uniform Plumbing Code and the National Plumbing Code of Canada by the International Association of Plumbing and Mechanical Officials (IAPMO).

### Construction

Eyewash bowl and push flag handle are stainless steel. Galvanized steel piping is additionally protected with BRADTECT™ safety yellow coating.

### Standard Equipment

#### Eyewash Bowl

10" (254mm) diameter corrosion-resistant stainless steel.

#### Standard Sprayhead Assembly

Chrome-plated brass sprayhead assembly with twin, soft flow, eyewash heads and protective sprayhead covers. The integral flow control assures safe, steady flow under varying water supply conditions from 30-90 PSI.

#### Frostproof Valve


Chrome-plated brass 1" IPS stay-open ball valve. Hand operated by a stainless steel push flag handle.

#### Pipe and Fittings

Galvanized steel protected with BRADTECT™ safety yellow coating. Standard wall thickness is 8"-12". Special order for other wall thicknesses. (0"-8" or 12"-18")

#### Water Supply


1/2" IPS.

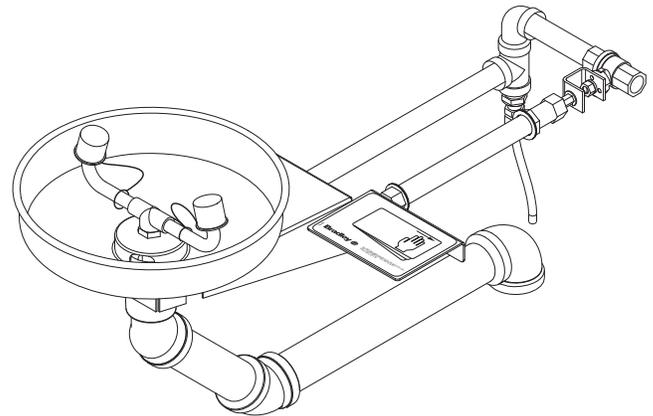

#### Recommended Option:

Navigator S19-2000 EFX8  
Emergency Thermostatic Mixing Valve

**NAVIGATOR**



Satisfies ANSI Z358.1-2004  
tepid water requirements.

Document No. 4330

This information is subject to change without formal notice.  
© 2007 Bradley Corporation  
8-16-2007 (2 Pages Total)

EF4330.1

**Bradley** 

P.O. Box 309, Menomonee Falls, WI 53052-0309  
Phone 1-800-BRADLEY FAX 262-251-5817  
Web Site: <http://www.bradleycorp.com>







**CERTIFIED  
MODEL  
Z358.1-2004**

# Frostproof, Wall-Mounted Eyewash Fixture Model S19-220HFP

## MODEL

Model No.	Description
<input type="checkbox"/> S19-220HFP	Frostproof, Wall-Mounted Eyewash
<input type="checkbox"/> S19-2000	Navigator EFX8 – Emergency Thermostatic Mixing Valve

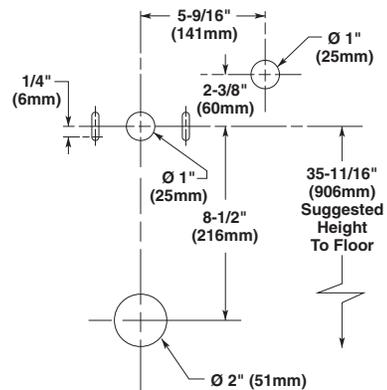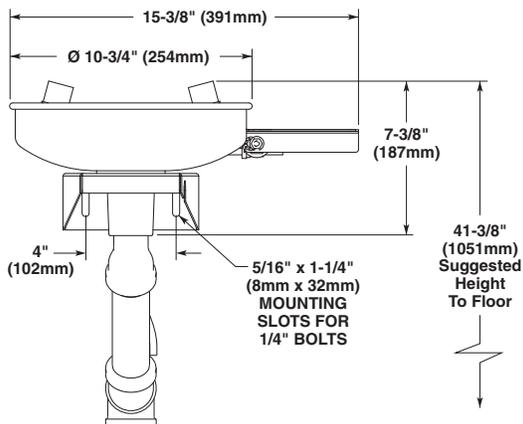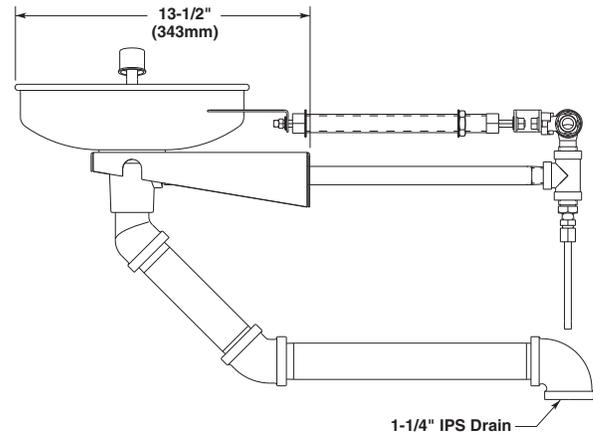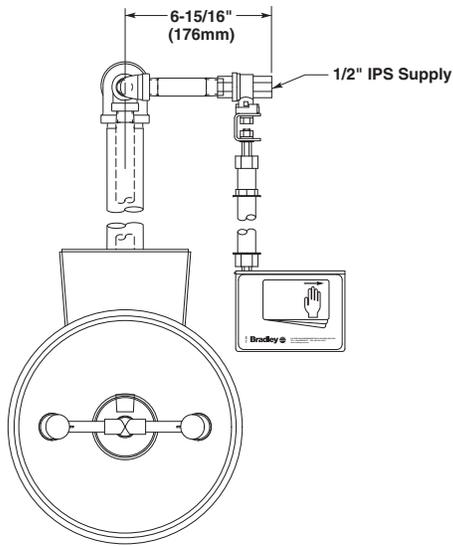

Document No. 4330

This information is subject to change without formal notice.  
© 2007 Bradley Corporation  
8-16-2007 (2 Pages Total)



P.O. Box 309, Menomonee Falls, WI 53052-0309  
Phone 1-800-BRADLEY FAX 262-251-5817  
Web Site: <http://www.bradleycorp.com>