

Deck-Mounted Eyewash Fixture

Model S19-230DT

- Complies with American National Standard Z358.1-2004
- Galvanized Steel Protected with BRADTECT™ Safety Yellow Coating
- Universal Identification Sign and Inspection Tag Included
- Full, One-Year Warranty

Specifications

Unit design saves space and fits easily into any work environment. Eyewash operates quickly by a large, highly visible push handle. Safe, steady water flow under varying water supply conditions from 30-90 PSI is assured by integral flow control in the sprayhead assembly.

UPC and cUPC Approved:

The Emergency Fixtures are certified to comply with the requirements of the Uniform Plumbing Code and the National Plumbing Code of Canada by the International Association of Plumbing and Mechanical Officials (IAPMO).

Construction

Eyewash bowl is corrosion-resistant stainless steel. Galvanized steel piping is additionally protected with BRADTECT™ safety yellow coating.

Standard Equipment

Eyewash Bowl

10" (254mm) diameter corrosion-resistant stainless steel.

Standard Sprayhead Assembly

Chrome-plated brass sprayhead assembly with twin, soft flow, eyewash heads and protective sprayhead covers. The integral flow control assures safe, steady flow under varying water supply conditions from 30-90 PSI.

Valve

Chrome-plated brass 1/2" IPS stay-open ball valve. Hand operated by a large, highly visible push handle.

Pipe and Fittings

Galvanized steel protected with BRADTECT™ safety yellow coating.

Waste

1-1/4" waste. Tailpiece and trap to conform to local codes by others.

Water Supply


1/2" IPS.



Recommended Option:

Navigator S19-2000 EFX8
Emergency Thermostatic Mixing Valve

NAVIGATOR



Satisfies ANSI Z358.1-2004
tepid water requirements.

Document No. 4420

This information is subject to change without formal notice.
© 2007 Bradley Corporation
1-15-2007 (2 Pages Total)

Bradley 

P.O. Box 309, Menomonee Falls, WI 53052-0309
Phone 1-800-BRADLEY FAX 262-251-5817
Web Site: <http://www.bradleycorp.com>

EF4420.1




SEI CERTIFIED
MODEL
Z358.1-2004

Deck-Mounted Eyewash Fixture

Model S19-230DT

MODEL	
Model No.	Description
<input type="checkbox"/> S19-230DT	Deck-Mounted Eyewash Fixture
<input type="checkbox"/> S19-2000	Navigator EFX8 – Emergency Thermostatic Mixing Valve

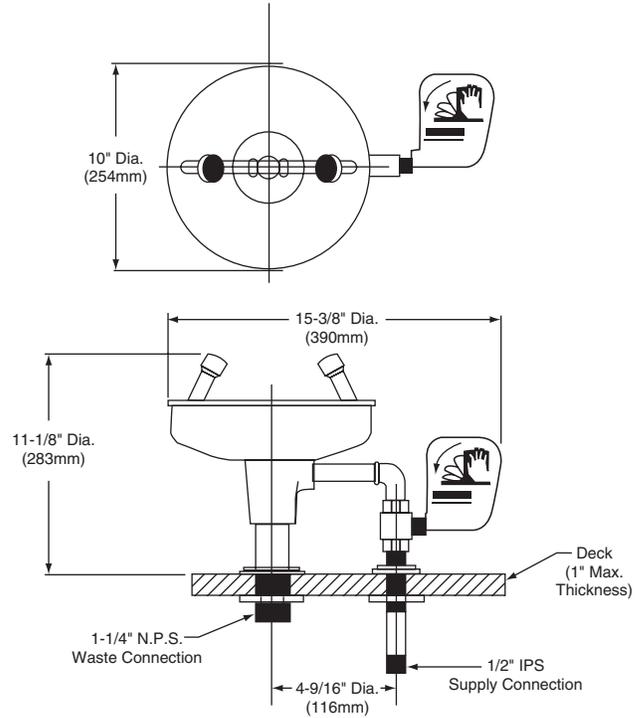

Document No. 4420

This information is subject to change without formal notice.
© 2007 Bradley Corporation
1-15-2007 (2 Pages Total)



P.O. Box 309, Menomonee Falls, WI 53052-0309
Phone 1-800-BRADLEY FAX 262-251-5817
Web Site: <http://www.bradleycorp.com>