


G3707
THERMOSTATIC MIXING VALVE FOR MULTIPLE EYE WASHES OR SINGLE EMERGENCY SHOWER, HOUSED IN RECESS MOUNTED STAINLESS STEEL CABINET

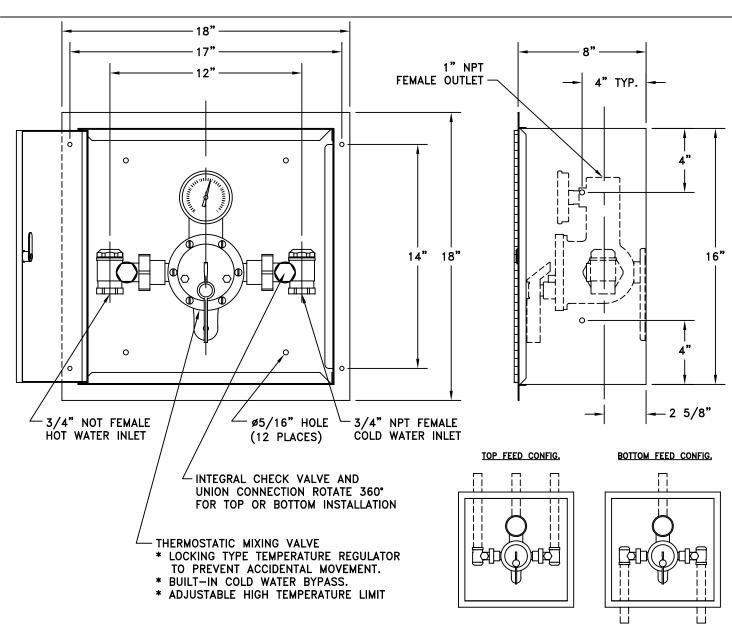

NOTE: ENCLOSURE IS 16 GAUGE BRUSHED STAINLESS STEEL CABINET WITH HINGED DOOR AND KEYED LOCK.

CAPACITIES	MINIMUM	INTERNAL COLD WATER BY-PASS	SYSTEM PRESSURE DROP									
	FLOW (GPM)		5	10	15)	20	25	30	35	40	45	PSI
	L\MIN	MINIMUM	.3	.7	1.0	1.4	1.7	2.1	2.4	2.8	3.1	BAR
	3	20	18	23	29	34	40	45	51	56	58	GPM
FLOW	11	76	68	87	110	129	151	170	193	212	220	L\MIN

WARNING
IT IS THE RESPONSIBILITY OF THE SPECIFIER TO DETERMINE THE DELIVERED
WATER TEMPERATURE TO EACH SAFETY FIXTURE. A COMFORTABLE RANGE IS
60°F TO 90°F (15°C TO 32°C). IN CIRCUMSTANCES WHERE A CHEMICAL REACTION
IS ACCELERATED BY WATER TEMPERATURE, A MEDICAL ADVISOR SHOULD BE
CONSULTED FOR THE OPTIMUM TEMPERATURE FOR EACH APPLICATION.

NOT

A LIMIT STOP, SET FOR 90°F (32°C), IS SIMPLY A MECHANICAL SETTING TO PREVENT EXCESSIVE HANDLE ROTATION. IF INCOMING WATER IS HOTTER THAN 150°F (66°C), THE TEMPERATURE OF THE FACTORY TEST, THE VALVE WHEN TURNED TO FULL HOT MAY DELIVER WATER IN EXCESS OF 90°F (32°C) AND THE LIMIT STOP MUST BE RESET BY THE INSTALLER!

UNITS (EXCEPT THOSE WITH SELF-CLOSING VALVES) COMPLY WITH THE REQUIREMENTS OF ANSI Z358.1.

TEST ALL EMERGENCY EQUIPMENT AT LEAST WEEKLY.

Drawing Number: G608-071 Approved: Revision Number: 111406-EJM