

T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690



Model No.


Item No.

EC-3100-TMV

Sheet: 1 of 2

ISO #9001

130 #9001

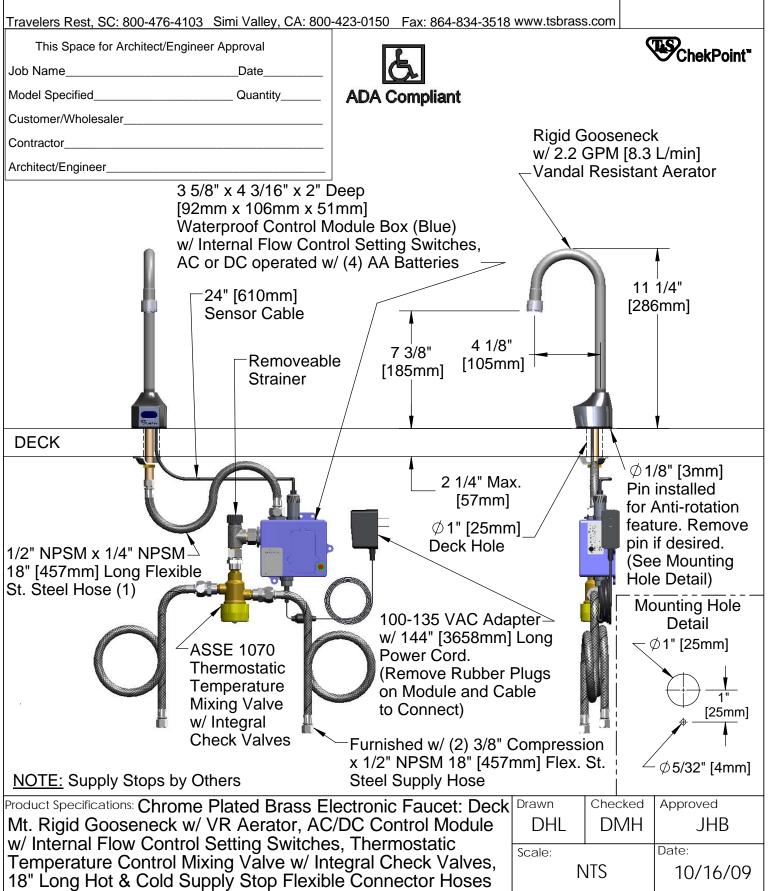



T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690



Model No.


EC-3100-TMV


6. #A2601 Item No.

Travelers Rest, SC: 800-476-4103 Simi Valley, CA: 800-423-0150 Fax: 864-834-3518 www.tsbrass.com



ITEM NO.	SALES NO.	DESCRIPTION	
1	B-0199-06	VR Aerator w/ Key	
2	044A	3/8" to Aerator Adapter	
3	006575-45	-015 O-Ring	
4	017195-45	Angled Sensor w/ Cable	
5	016297-45	Inlet Hose, Faucet, 1/2" NPSM-F x 1/4" NPSM-F	
6	EC-FILTER	Replacement Filter	
7	016647-45	ChekPoint Electronic Module (Blue)	
8	5EF-0002	A/C Transformer	
9	016061-25	Adapter 9/16-24UN Female x 1/2-14NPSM Male	
9		Chrome Plated	
10	EC-TMV	ASSE 1070 Thermostatic Mixing Valve	
11	5EF-0005	Supply Hose, 9/16-24 Female x 1/2" NPSM	
12	Q015425-45	5-45 Vandal Resistant Key	

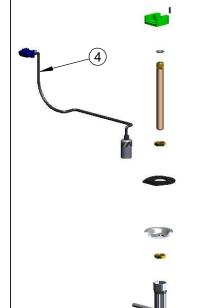

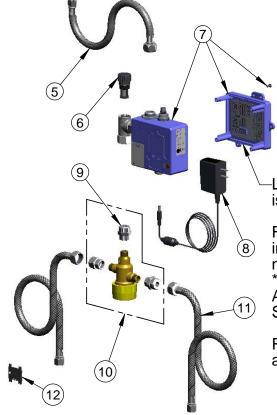

-Label for Flow Control Switch Settings is located on Inside of Back Cover.

Flow Control Switches are located inside Module Housing in Black Box next to Battery Compartment.
*Switches are set to DEFAULT position: Auto Time Out = 10 seconds
Shut Off Delay = 1 second

Remove (4) screws and back cover to access switches.

*Available Water Flow Control Selections:

- (6) Auto Time Out Selections 10 sec, 25 sec, 45 sec, 60 sec, 3 min, 20 min
- (4) Shut Off Delay Selections 1 sec, 2 sec, 4 sec, 5 sec, 6 sec

Product Specifications: Chrome Plated Brass Electronic Faucet: Deck Mt. Rigid Gooseneck w/ VR Aerator, AC/DC Control Module w/ Internal Flow Control Setting Switches, Thermostatic Temperature Control Mixing Valve w/ Integral Check Valves, 18" Long Hot & Cold Supply Stop Flexible Connector Hoses

Drawn	Checked	Approved
DHL	DMH	JHB
Scale:		Date:
N	TS	10/16/09

Sheet: 2 of 2